




THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF  
VERSATUBE BUILDING SYSTEMS ANY REPRODUCTION IN PART OR WHOLE WITHOUT  
THE WRITTEN PERMISSION OF VERSATUBE BUILDING SYSTEMS IS PROHIBITED.

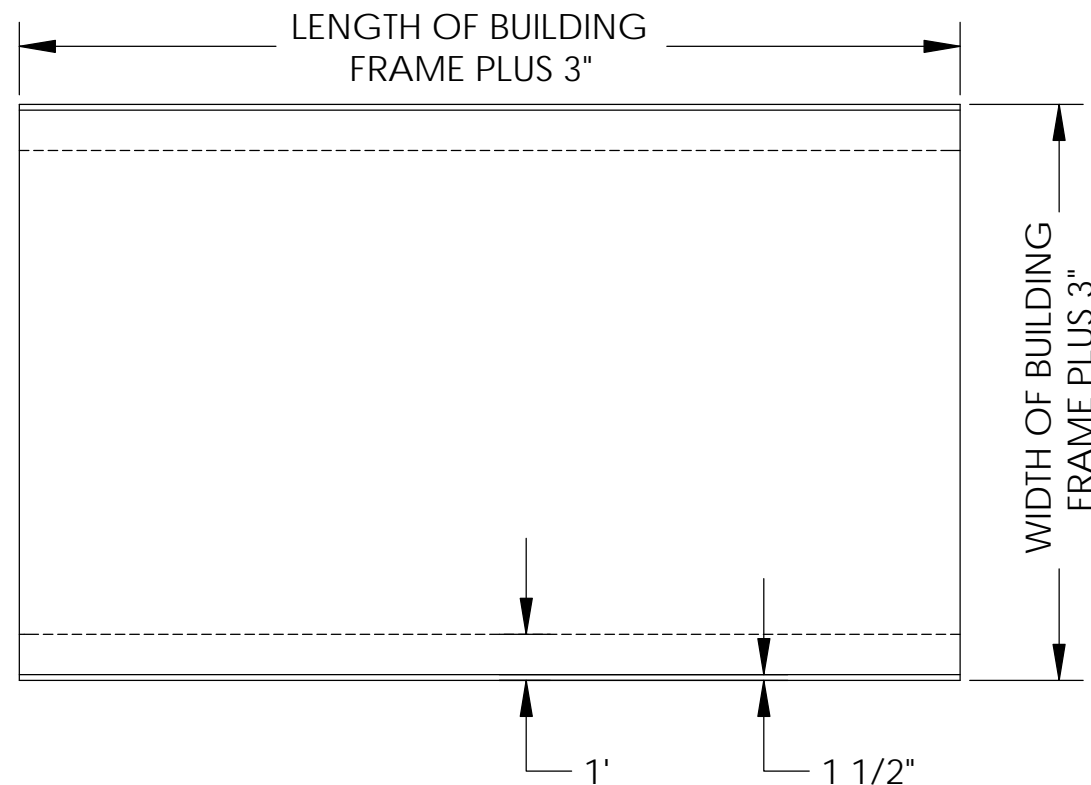

SHEETING LEDGE



TYPICAL SECTION VIEW

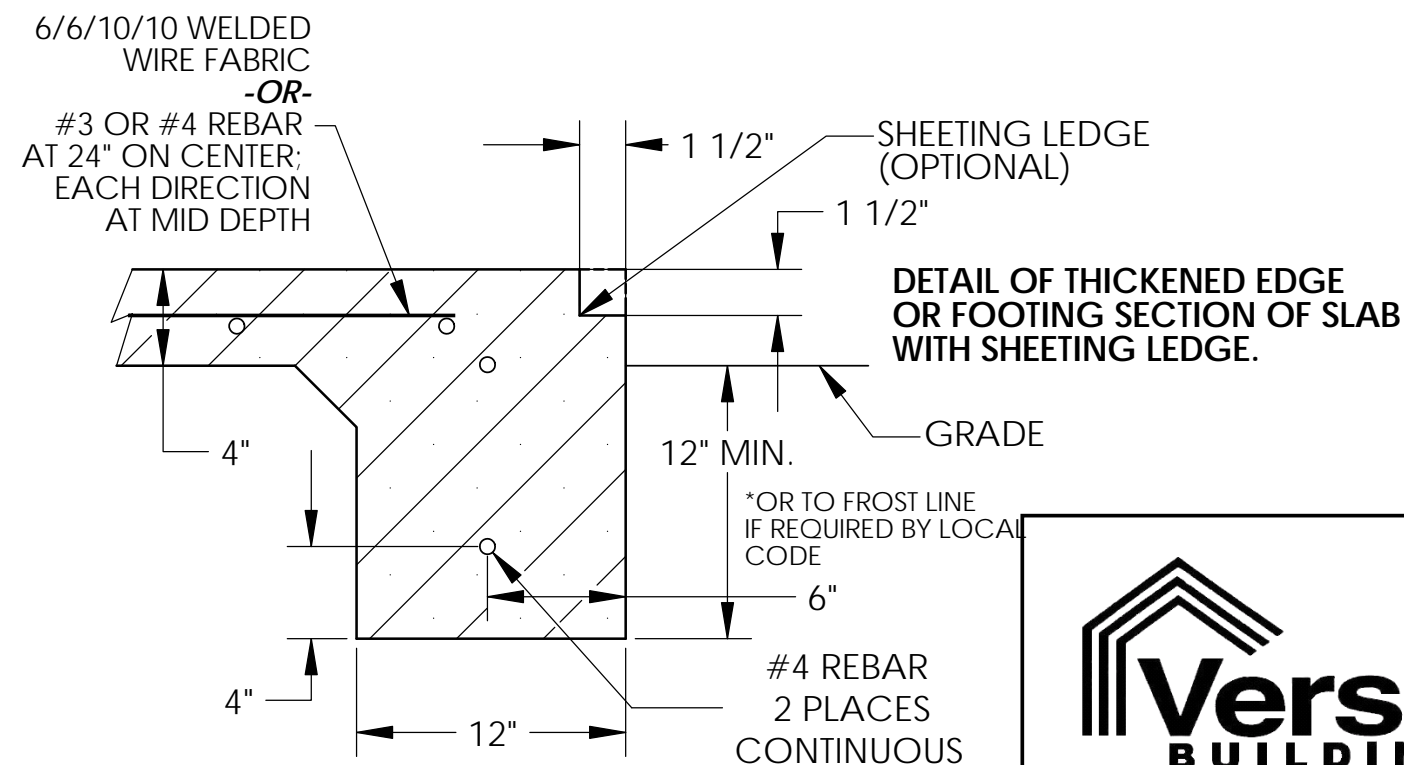

FRAME WxL	CONCRETE WxL (OUTSIDE DIM.)
12'-0" X 20'-2"	12'-3" X 20'-5"
12'-0" X 30'-2"	12'-3" X 30'-5"
20'-0" X 20'-2"	20'-3" X 20'-5"
24'-0" X 20'-2"	24'-3" X 20'-5"

**REQUIRED FOUNDATION/SLAB SIZE FOR VERTICALLY SHEETED CARPORTS, ROOF ONLY AND HORIZ. SHEETED EAVE SIDES ENCL.**

**NOTE: ALL VERSATUBE GRAND STYLE CARPORTS ARE 2" LONGER THAN ADVERTISED.**

**DIMENSIONS ARE OUTSIDE TO OUTSIDE OF SLAB. THE SLAB OUT TO OUT DIMENSIONS MUST BE 3" WIDER AND 3" LONGER THAN THE BUILDING SIZE.**

**EXAMPLE:**  
20'W X 40'-2"L X 10'H BUILDING WOULD HAVE A SLAB  
DIMENSION OF 20'-3"W X 40'-5"L.

FOR FURTHER QUESTIONS OR CONCERNS ABOUT BUILDING OR SLAB LENGTH,  
CONTACT A PRODUCT & DESIGN ENGINEER AT VERSATUBE TOLL FREE AT 1-800-900-7222.

GENERAL FOUNDATION NOTES:

1. MAXIMUM ALLOWABLE SOIL BEARING PRESSURE IS 1500PSF IN ACCORDANCE WITH APPLICABLE CODE. OWNER TO VERIFY THAT SOIL IS STABLE AND COMPACTED TO A MINIMUM OF 95% RELATIVE OPTIMUM VALUE.
2. MAXIMUM SIZE CONCRETE AGGREGATE SHALL BE 1" DIA.
3. MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS SHALL BE 2500 PSI.
4. PLACE REINFORCEMENT AT MID DEPTH FOR SLABS ON GRADE.
5. ALL SPLICES IN CONTINUOUS REINFORCEMENT OR REINFORCING SHALL HAVE A MINIMUM LAP OF 40 DIAMETERS. SPLICES IN ADJACENT BARS SHALL NOT BE LESS THAN 4'-0" APART. VERTICAL WALL BARS SHALL BE SPLICED AT OR NEAR FLOOR LINES. BARS MAY BE WIRED TOGETHER AT SPLICES OR LAPS EXCEPT FOR TOP REINF. OF BEAM AND SLABS, OR WHERE SPECIFICALLY DETAILED TO BE SEPARATED.
6. CONCRETE SHALL BE PLACED IN ACCORDANCE WITH THE LATEST ACI SPECIFICATIONS.

**THIS IS STRICTLY A SUGGESTED FOUNDATION DESIGN. OTHER ENGINEERED DESIGNS  
MAY BE SUBSTITUTED OR DICTATED BY YOUR MUNICIPALITY OR INSPECTOR.**



UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE: FRACTIONS   DECIMALS   ANGLES  +        .XX+ .XX   + 1        -        -  .XXX+ .XXX        -  MATERIAL  2,500 PSI CONCRETE  FINISH   DO NOT SCALE DRAWING	CAD GENERATED DRAWING, DO NOT MANUALLY UPDATE		VERSATUBE BUILDING SYSTEMS			
	APPROVALS	DATE	MONOSLAB FOUNDATION FOR GRAND STYLE CARPORTS			
	DRAWN STRICKER	6/3/15				
	CHECKED					
	RESP ENG					
	MFG ENG		SIZE B	DWG. NO.	GRAND CP FOUNDATION WITH SIZES	REV.
	QUAL ENG		SCALE	CAD FILE:	SHEET 1 OF 1	